


**NURSING HOME** 


# **ECONOPAK<sup>TM</sup>**



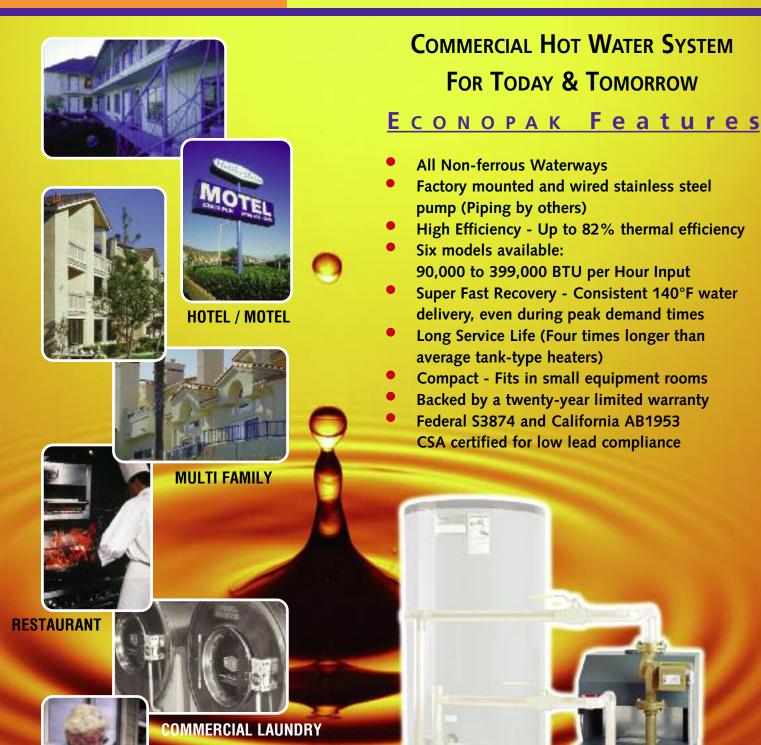


## **ECONOPAK™ - COMMERCIAL HOT WATER SYSTEM**

### MODELS WH-90, WH-135, WH-195

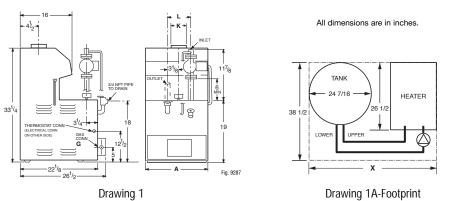


#### MODELS WH-260, WH-330, WH-400

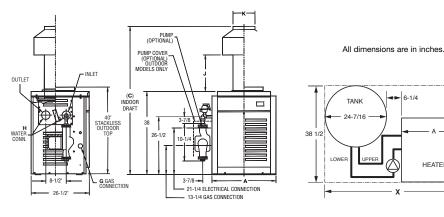

#### Drawing 2 Drawing 2A-Footprint

#### **80-GALLON TANK** Tank must be ordered seperately

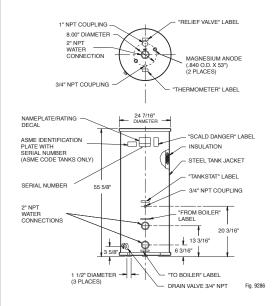

TANK SIZE (GALLONS)	TYPE	SHIPPING WEIGHT (LBS)					
80	CODE	255					
80	NON-CODE	198					

					RECOVERY									SHIPPING	MINIMUM CLEARANCE FROM COMBUSTIBLE MATERIALS						
REF DWG	MODEL Size	INPUT (MBTUH)	IN- DOOR	OUT- DOOR	∆T=100° F (GPH)**	WIDTH A	HEIGHT C	GAS CONN. G	WATER CONN. H	J	FLUE DIA. K	L	FOOT- PRINT X	WEIGHT (LBS)	FLOOR	FRONT	RIGHT REAR LEFT SIDE RIGHT SIDE	INDOOR TOP	OUTDOOR TOP	VENT	
1	WH-90	90	•		90	11	-	1/2	1	-	5	5 3/4	47	105	COMBUSTIBLE	SEE NOTE	6	16	N/A	6	
	WH-135	135	•		132	18	-	1/2	1 1/4	-	6	6 1/4	50 1/4	135	COMBUSTIBLE	SEE NOTE	6	16	N/A	6	
	WH-195	195	•		192	18	-	1/2	1 1/4	-	7	6 1/4	50 1/4	140	COMBUSTIBLE	SEE NOTE	6	16	N/A	6	
2	WH-260	264	•	•	262	22 3/8	62 7/8	3/4	1 1/2	11 1/8	7	-	53	290	COMBUSTIBLE*	SEE NOTE	12	39	UNOBSTRUCTED	6	
	WH-330	334	•	•	332	25 3/4	63 3/4	3/4	1 1/2	10 3/4	8	-	56 1/2	390	COMBUSTIBLE*	SEE NOTE	12	39	UNOBSTRUCTED	6	
	WH-400	399	•	•	396	29 1/4	65 3/8	1	1 1/2	12 1/2	9	-	60	405	COMBUSTIBLE*	SEE NOTE	12	39	UNOBSTRUCTED	6	

26-1/2

HEATER











<sup>\*</sup> Installation on combustible floor requires optional shield. \*\* Based on manufacturer's rating. Models available for use with either Natural Gas or Propane. A front clearance of at least 24 inches is recommended for adequate service of burner tray and controls. Ratings shown are for elevations up to 2,000 feet. Ratings should be reduced at the rate of 4% for each 1,000 feet above sea level.